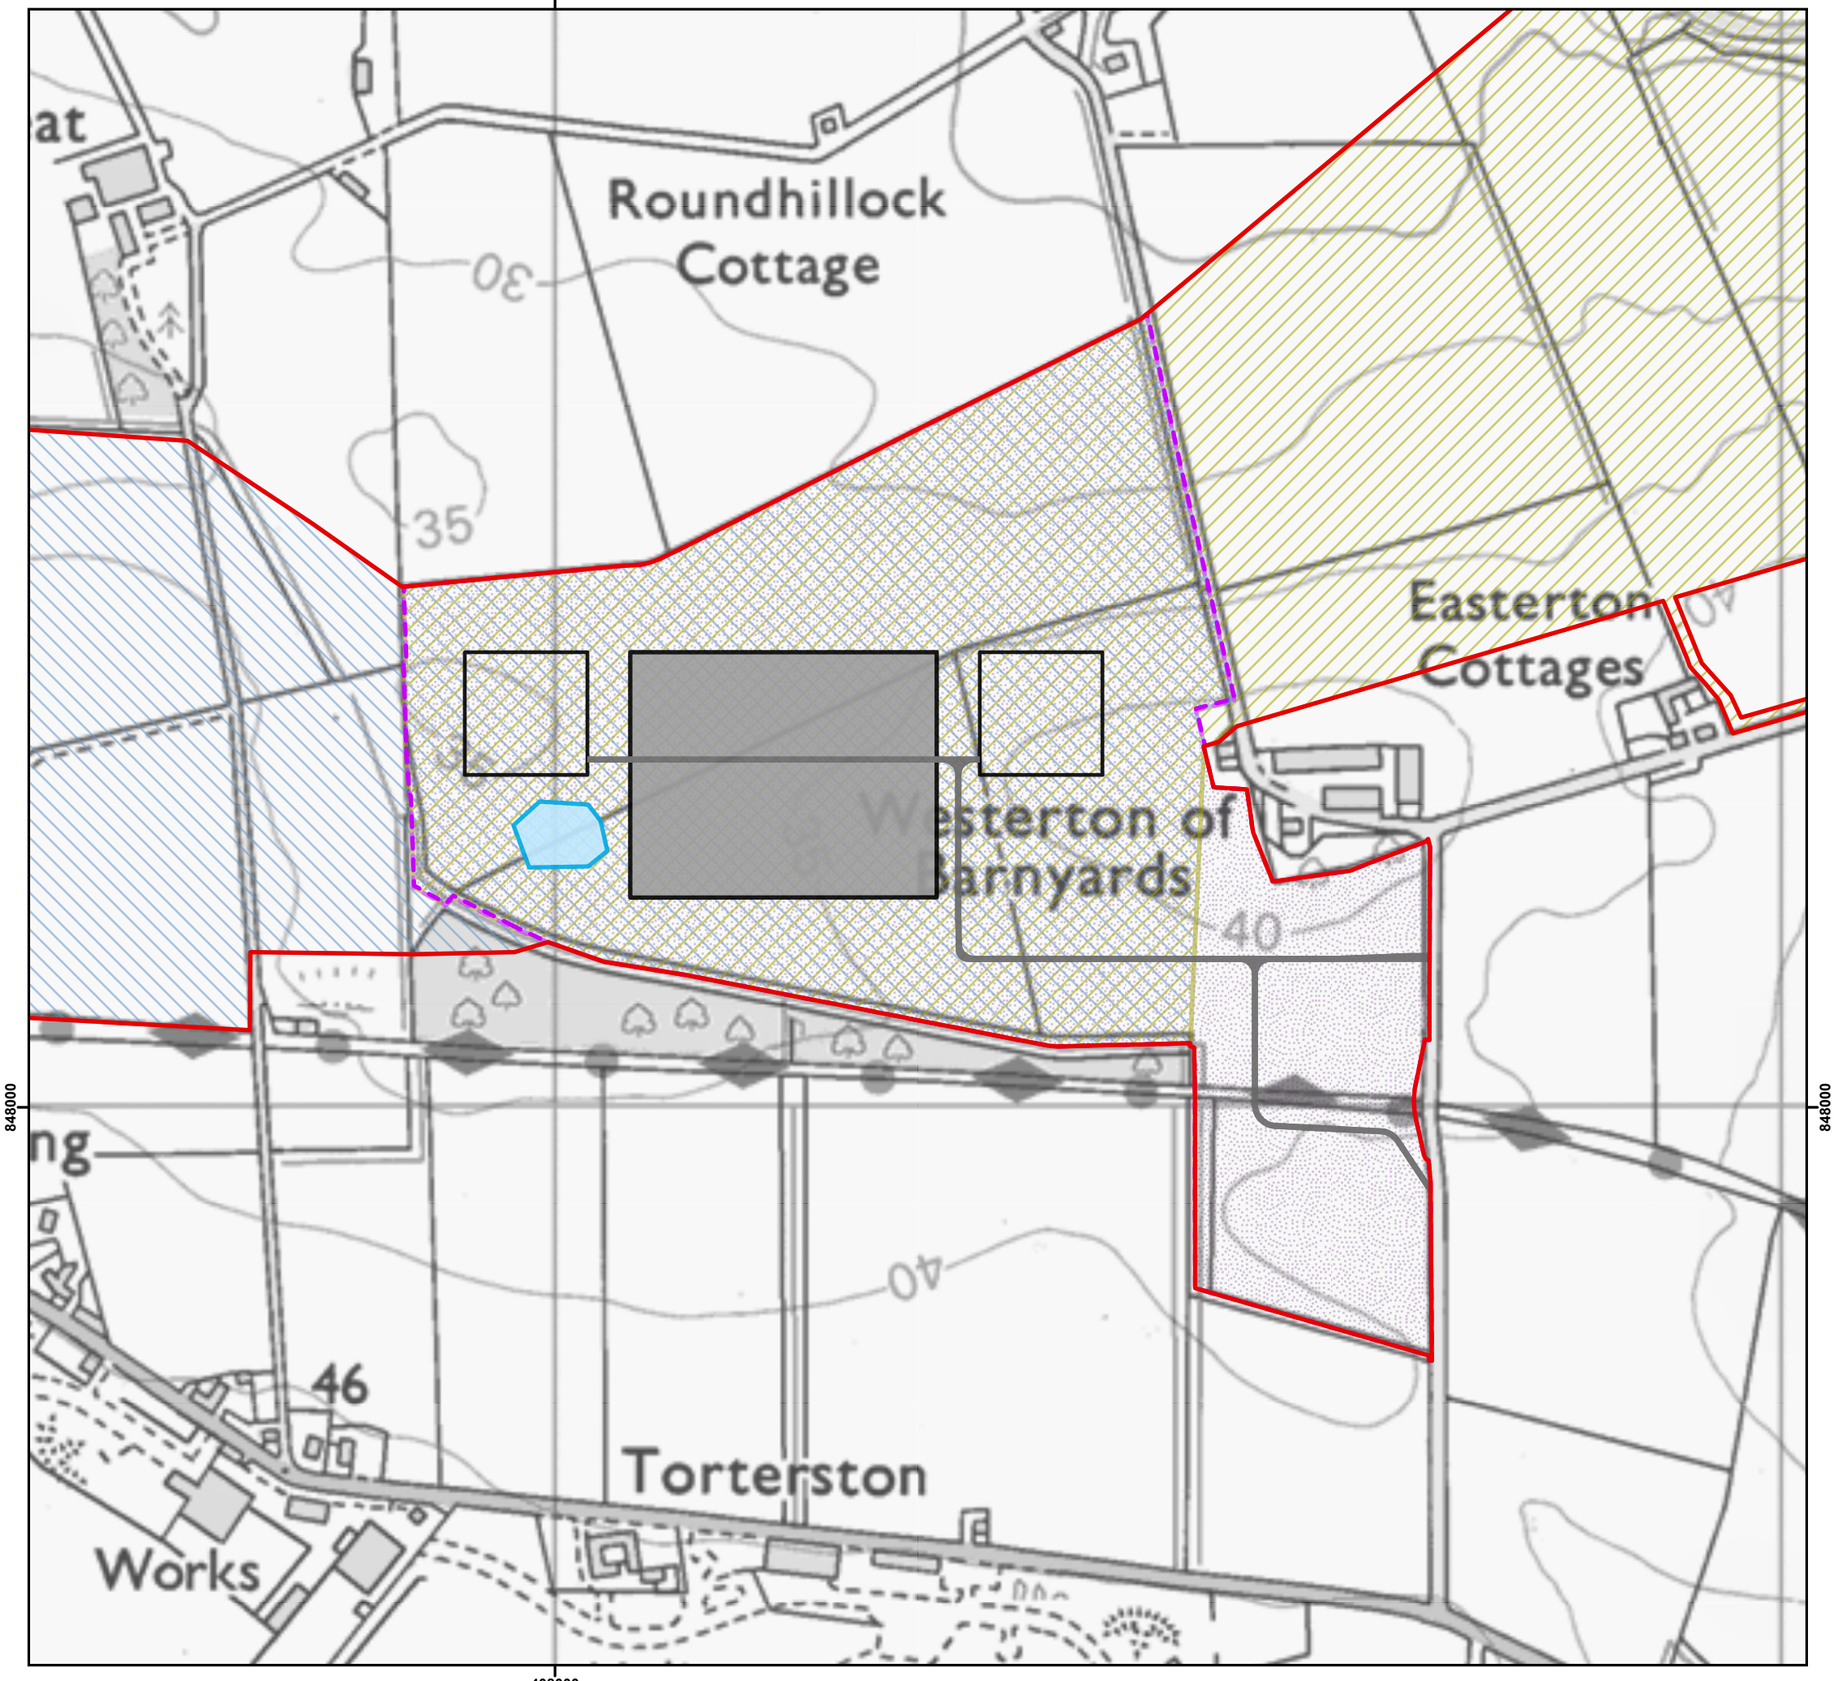

Legend:

- Site boundary

Onshore development zones

- Cable corridor zone A
- Substation zone
- Cable corridor zone B

Substation layout

- 100 x 100m temporary construction compound
- Indicative 200 x 250m substation area
- Indicative SuDS (Sustainable Urban Drainage System)
- Indicative track

Project:	Report:
Muir Mhòr Offshore Wind Farm	**Application Drawing**

Title:

Proposed 275kV to 400kV Substation Zone Site Plan (Enclosed and External) (Indicative)

Figure: **4**	Drawing No: 004		
Revision: 000	Date: 03/12/2024	Drawn: SR	Checked: JW

Map scale: 1:5,000 @ A3

0 0.1 0.2 km

N

Co-ordinate system: EPSG: 27700

MUIR MHÒR OFFSHORE WIND FARM

A joint venture between Fred. Olsen Seawind & Vattenfall

Source: Fred Olsen

© Crown copyright and database rights 2024 Ordnance Survey 0100031673.